

# TECHNICAL SPECIFICATION



**Power installations exceeding 1 kV a.c. and 1,5 kV d.c. –  
Part 2: d.c.**



## THIS PUBLICATION IS COPYRIGHT PROTECTED

Copyright © 2015 IEC, Geneva, Switzerland

All rights reserved. Unless otherwise specified, no part of this publication may be reproduced or utilized in any form or by any means, electronic or mechanical, including photocopying and microfilm, without permission in writing from either IEC or IEC's member National Committee in the country of the requester. If you have any questions about IEC copyright or have an enquiry about obtaining additional rights to this publication, please contact the address below or your local IEC member National Committee for further information.

IEC Central Office  
3, rue de Varembe  
CH-1211 Geneva 20  
Switzerland

Tel.: +41 22 919 02 11  
Fax: +41 22 919 03 00  
[info@iec.ch](mailto:info@iec.ch)  
[www.iec.ch](http://www.iec.ch)

### About the IEC

The International Electrotechnical Commission (IEC) is the leading global organization that prepares and publishes International Standards for all electrical, electronic and related technologies.

### About IEC publications

The technical content of IEC publications is kept under constant review by the IEC. Please make sure that you have the latest edition, a corrigenda or an amendment might have been published.

#### IEC Catalogue - [webstore.iec.ch/catalogue](http://webstore.iec.ch/catalogue)

The stand-alone application for consulting the entire bibliographical information on IEC International Standards, Technical Specifications, Technical Reports and other documents. Available for PC, Mac OS, Android Tablets and iPad.

#### IEC publications search - [www.iec.ch/searchpub](http://www.iec.ch/searchpub)

The advanced search enables to find IEC publications by a variety of criteria (reference number, text, technical committee,...). It also gives information on projects, replaced and withdrawn publications.

#### IEC Just Published - [webstore.iec.ch/justpublished](http://webstore.iec.ch/justpublished)

Stay up to date on all new IEC publications. Just Published details all new publications released. Available online and also once a month by email.

#### Electropedia - [www.electropedia.org](http://www.electropedia.org)

The world's leading online dictionary of electronic and electrical terms containing more than 30 000 terms and definitions in English and French, with equivalent terms in 15 additional languages. Also known as the International Electrotechnical Vocabulary (IEV) online.

#### IEC Glossary - [std.iec.ch/glossary](http://std.iec.ch/glossary)

More than 60 000 electrotechnical terminology entries in English and French extracted from the Terms and Definitions clause of IEC publications issued since 2002. Some entries have been collected from earlier publications of IEC TC 37, 77, 86 and CISPR.

#### IEC Customer Service Centre - [webstore.iec.ch/csc](http://webstore.iec.ch/csc)

If you wish to give us your feedback on this publication or need further assistance, please contact the Customer Service Centre: [csc@iec.ch](mailto:csc@iec.ch).

# TECHNICAL SPECIFICATION



**Power installations exceeding 1 kV a.c. and 1,5 kV d.c. –  
Part 2: d.c.**

INTERNATIONAL  
ELECTROTECHNICAL  
COMMISSION

ICS 29.020; 29.080.01

ISBN 978-2-8322-2304-8


**Warning! Make sure that you obtained this publication from an authorized distributor.**

## CONTENTS

FOREWORD.....	5
INTRODUCTION.....	8
1 Scope.....	9
2 Normative references .....	9
3 Terms and definitions .....	10
4 Fundamental requirements .....	12
4.1 General.....	12
4.1.1 General requirements .....	12
4.1.2 Agreements between supplier (manufacturer) and user .....	12
4.2 Electrical requirements .....	12
4.2.1 Methods of d.c. neutral point earthing .....	12
4.2.2 Voltage classification .....	13
4.2.3 Current in normal operation .....	13
4.2.4 Short-circuit current .....	13
4.2.5 Rated frequency .....	13
4.2.6 Corona .....	13
4.2.7 Electric and magnetic fields .....	14
4.2.8 Overvoltages .....	14
4.2.9 Harmonics .....	14
4.2.10 Galvanic separation between a.c. and d.c. systems .....	14
4.3 Mechanical requirements .....	14
4.4 Climatic and environmental conditions .....	14
4.4.1 General .....	14
4.4.2 Normal conditions .....	15
4.4.3 Special conditions .....	15
4.5 Special requirements .....	15
5 Insulation.....	15
5.1 General.....	15
5.2 Selection of insulation level.....	15
5.2.1 Consideration of methods of neutral earthing.....	15
5.2.2 Consideration of rated withstand voltages.....	15
5.3 Verification of withstand values.....	16
5.4 Minimum clearances of live parts .....	16
5.5 Minimum clearances between parts under special conditions .....	18
5.6 Tested connection zones .....	18
6 Equipment .....	18
6.1 General requirements .....	18
6.2 Specific requirements .....	18
6.2.1 Switching devices .....	18
6.2.2 Reactors.....	18
6.2.3 Prefabricated type-tested switchgear .....	19
6.2.4 Surge arresters.....	19
6.2.5 Capacitors .....	19
6.2.6 Line traps .....	19
6.2.7 Insulators .....	19
6.2.8 Insulated cables .....	19

6.2.9	Conductors and accessories .....	20
6.2.10	Rotating electrical machines .....	20
6.2.11	Static converters .....	20
6.2.12	Fuses .....	20
6.2.13	Electrical and mechanical Interlocking .....	20
6.2.14	Electronic valve devices .....	20
6.2.15	Valve cooling system .....	20
7	Installations .....	21
7.1	General requirements .....	21
7.1.1	Circuit arrangement .....	21
7.1.2	Documentation .....	21
7.1.3	Transport routes .....	21
7.1.4	Aisles and access areas .....	21
7.1.5	Lighting .....	21
7.1.6	Operational safety .....	21
7.1.7	Labelling .....	21
7.2	Outdoor installations of open design .....	21
7.2.1	Protective barrier clearances .....	22
7.2.2	Protective obstacle clearances .....	22
7.2.3	Boundary clearances .....	22
7.2.4	Minimum height over access area .....	22
7.2.5	Clearances to buildings .....	23
7.2.6	External fences or walls and access doors .....	25
7.3	Indoor installations of open design .....	25
7.4	Installation of prefabricated type-tested switchgear .....	25
7.5	Requirements for buildings .....	25
7.5.1	General .....	25
7.5.2	Structural provisions .....	25
7.5.3	Rooms for switchgear .....	26
7.5.4	Maintenance and operating areas .....	26
7.5.5	Doors .....	26
7.5.6	Draining of insulating liquids .....	26
7.5.7	Air conditioning and ventilation .....	26
7.5.8	Buildings which require special consideration .....	27
7.6	High voltage/low voltage prefabricated substations .....	27
7.7	Electrical installations on mast, pole and tower .....	27
8	Safety measures .....	27
8.1	General .....	27
8.2	Protection against direct contact .....	27
8.2.1	Measures for protection against direct contact .....	27
8.2.2	Protection requirements .....	27
8.3	Means to protect persons in case of indirect contact .....	28
8.4	Means to protect persons working on electrical installations .....	28
8.5	Protection from danger resulting from arc fault .....	28
8.6	Protection against direct lightning strokes .....	28
8.7	Protection against fire .....	28
8.8	Protection against leakage of insulating liquid .....	28
8.9	Identification and marking .....	28
9	Protection, control and auxiliary systems .....	28

10	Earthing systems .....	29
10.1	General.....	29
10.2	Fundamental requirements.....	29
10.2.1	Safety criteria .....	29
10.2.2	Functional requirements .....	30
10.2.3	High and low voltage earthing systems .....	30
10.3	Design of earthing systems .....	30
10.3.1	General .....	30
10.3.2	Power system faults.....	31
10.3.3	Lightning and transients.....	31
10.4	Construction of earthing systems .....	31
10.5	Measurements .....	31
10.6	Maintainability.....	31
10.6.1	Inspections .....	31
10.6.2	Measurements.....	32
11	Inspection and testing.....	32
11.1	General.....	32
11.2	Verification of specified performances.....	32
11.3	Tests during installation and commissioning .....	32
11.4	Trial running .....	32
12	Operation and maintenance manual .....	32
	Annex A (informative) Values of rated insulation levels and minimum clearances in air based on nominal voltage of some HVDC projects worldwide.....	33
	Annex B (normative) Method of calculating the voltage limit.....	35
	Bibliography.....	36
	Figure 1 – Approaches with buildings (within closed electrical operating areas) .....	24
	Figure 2 – Touch voltage limit d.c. ....	30

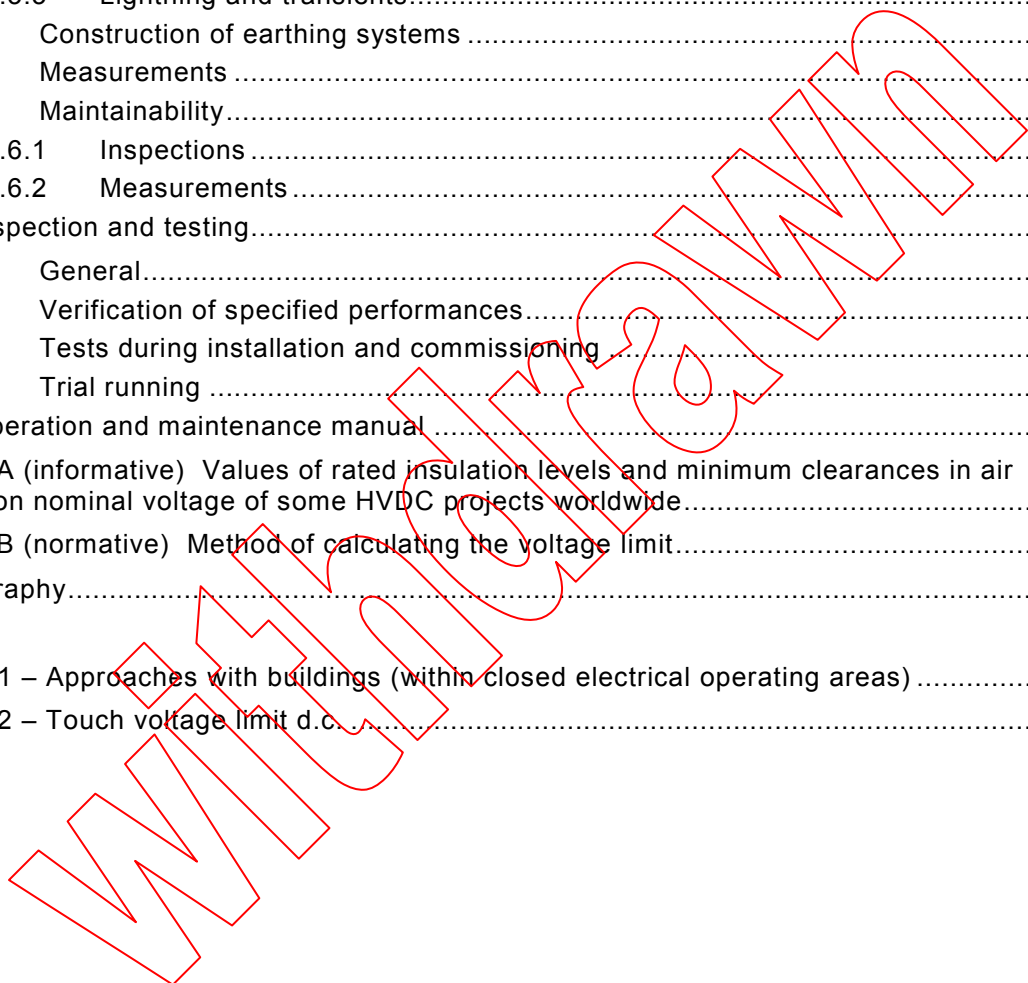

## INTERNATIONAL ELECTROTECHNICAL COMMISSION

**POWER INSTALLATIONS EXCEEDING 1 kV a.c. and 1,5 kV d.c. –****Part 2: d.c.**

## FOREWORD

- 1) The International Electrotechnical Commission (IEC) is a worldwide organization for standardization comprising all national electrotechnical committees (IEC National Committees). The object of IEC is to promote international co-operation on all questions concerning standardization in the electrical and electronic fields. To this end and in addition to other activities, IEC publishes International Standards, Technical Specifications, Technical Reports, Publicly Available Specifications (PAS) and Guides (hereafter referred to as "IEC Publication(s)"). Their preparation is entrusted to technical committees; any IEC National Committee interested in the subject dealt with may participate in this preparatory work. International, governmental and non-governmental organizations liaising with the IEC also participate in this preparation. IEC collaborates closely with the International Organization for Standardization (ISO) in accordance with conditions determined by agreement between the two organizations.
- 2) The formal decisions or agreements of IEC on technical matters express, as nearly as possible, an international consensus of opinion on the relevant subjects since each technical committee has representation from all interested IEC National Committees.
- 3) IEC Publications have the form of recommendations for international use and are accepted by IEC National Committees in that sense. While all reasonable efforts are made to ensure that the technical content of IEC Publications is accurate, IEC cannot be held responsible for the way in which they are used or for any misinterpretation by any end user.
- 4) In order to promote international uniformity, IEC National Committees undertake to apply IEC Publications transparently to the maximum extent possible in their national and regional publications. Any divergence between any IEC Publication and the corresponding national or regional publication shall be clearly indicated in the latter.
- 5) IEC itself does not provide any attestation of conformity. Independent certification bodies provide conformity assessment services and, in some areas, access to IEC marks of conformity. IEC is not responsible for any services carried out by independent certification bodies.
- 6) All users should ensure that they have the latest edition of this publication.
- 7) No liability shall attach to IEC or its directors, employees, servants or agents including individual experts and members of its technical committees and IEC National Committees for any personal injury, property damage or other damage of any nature whatsoever, whether direct or indirect, or for costs (including legal fees) and expenses arising out of the publication, use of, or reliance upon, this IEC Publication or any other IEC Publications.
- 8) Attention is drawn to the Normative references cited in this publication. Use of the referenced publications is indispensable for the correct application of this publication.
- 9) Attention is drawn to the possibility that some of the elements of this IEC Publication may be the subject of patent rights. IEC shall not be held responsible for identifying any or all such patent rights.

The main task of IEC technical committees is to prepare International Standards. In exceptional circumstances, a technical committee may propose the publication of a technical specification when

- the required support cannot be obtained for the publication of an International Standard, despite repeated efforts, or
- the subject is still under technical development or where, for any other reason, there is the future but no immediate possibility of an agreement on an International Standard.

Technical specifications are subject to review within three years of publication to decide whether they can be transformed into International Standards.

IEC 61936-2, which is a technical specification, has been prepared by technical committee 99: System engineering and erection of electrical power installations in systems with nominal voltages above 1 kV a.c. and 1,5 kV d.c., particularly concerning safety aspects.

Future standards in this series will carry the new general title as cited above. Titles of existing standards in this series will be updated at the time of the next edition.

The text of this technical specification is based on the following documents:

Enquiry draft	Report on voting
99/130/DTS	99/132/RVC

Full information on the voting for the approval of this technical specification can be found in the report on voting indicated in the above table.

This publication has been drafted in accordance with the ISO/IEC Directives, Part 2.

A list of all parts in the IEC 61936 series, published under the general title *Power installations exceeding 1 kV a.c. and 1,5 kV d.c.*, can be found on the IEC website.

The following differences exist in the countries indicated below.

7.2.4: For live parts without protective facilities, a minimum height  $H = N + 2\,440$  mm shall be maintained. (Australia)

7.2.6: Guidance reference construction can be found at ENA Doc 015. (Australia)

7.5.4: Space for evacuation shall always be at least 600 mm, even when removable parts or open doors, which are blocked in the direction of escape, intrude into the escape routes. (Australia)

8.7.1: Fire rating of barriers must be a minimum fire rating of 120 minutes. (Australia)

8.7.2: The dimensions  $G_1$  and  $G_2$  are to be measured from the inside edge wall of any bund wall rather than the measured point shown in Figure 7a) and 7b) of IEC 61936-1:2010/AMD1:2014 from the transformer where the bund wall is wider than the transformer. (Australia)

8.8: Spill containment should extend by 50% of the height of the transformer. (Australia)

10: For requirements on earthing, refer to AS 2067, Substations and High Voltage Installations. (Australia)

10.2.1: HV earthing systems should be designed according to tolerable voltages based on body impedances not exceeded by 5 % of the population, as given in Table 10 of IEC TS 60479-1:2005. (United Kingdom)

10.2.1: Permissible touch and step voltages in power installations shall be in accordance with Federal law concerning electrical installations (High and low voltage) (SR 734.0) and Regulations for electrical power installations (SR 743.2 StV). (Switzerland)

10.2.1 and Annex B: Earthing requirements are based on probabilistic calculations and so much of the clause is not appropriate for Australia. (Australia)

The committee has decided that the contents of this publication will remain unchanged until the stability date indicated on the IEC website under "<http://webstore.iec.ch>" in the data related to the specific publication. At this date, the publication will be

- transformed into an International standard,
- reconfirmed,
- withdrawn,
- replaced by a revised edition, or
- amended.

A bilingual version of this publication may be issued at a later date.

**IMPORTANT – The 'colour inside' logo on the cover page of this publication indicates that it contains colours which are considered to be useful for the correct understanding of its contents. Users should therefore print this document using a colour printer.**

Withdrawn

## INTRODUCTION

There are few national laws, standards and internal rules dealing with the matter coming within the scope of this technical specification, and these practices have been taken as a basis for this work.

This part of IEC 61936 contains the minimum requirements valid for IEC countries and some additional information which ensures an acceptable reliability of an installation and its safe operation.

This part of IEC 61936 is published as a Technical Specification in order to welcome contribution and involvement from a wider audience. This may provide the basis for a future international standard.

The publication of this technical specification is believed to be a decisive step towards the gradual alignment all over the world of the practices concerning the design and erection of high voltage power installations.

Particular requirements for transmission and distribution installations as well as particular requirements for power generation and industrial installations are included in this technical specification.

The relevant laws or regulations of an authority having jurisdiction takes precedence.

Withdrawing