

# INTERNATIONAL STANDARD

**Industrial communication networks – Fieldbus specifications –  
Part 3-3: Data-link layer service definition – Type 3 elements**

Withhold



## THIS PUBLICATION IS COPYRIGHT PROTECTED

Copyright © 2007 IEC, Geneva, Switzerland

All rights reserved. Unless otherwise specified, no part of this publication may be reproduced or utilized in any form or by any means, electronic or mechanical, including photocopying and microfilm, without permission in writing from either IEC or IEC's member National Committee in the country of the requester.

If you have any questions about IEC copyright or have an enquiry about obtaining additional rights to this publication, please contact the address below or your local IEC member National Committee for further information.

IEC Central Office  
3, rue de Varembe  
CH-1211 Geneva 20  
Switzerland  
Email: [inmail@iec.ch](mailto:inmail@iec.ch)  
Web: [www.iec.ch](http://www.iec.ch)

### About the IEC

The International Electrotechnical Commission (IEC) is the leading global organization that prepares and publishes International Standards for all electrical, electronic and related technologies.

### About IEC publications

The technical content of IEC publications is kept under constant review by the IEC. Please make sure that you have the latest edition, a corrigenda or an amendment might have been published.

- Catalogue of IEC publications: [www.iec.ch/searchpub](http://www.iec.ch/searchpub)

The IEC on-line Catalogue enables you to search by a variety of criteria (reference number, text, technical committee,...). It also gives information on projects, withdrawn and replaced publications.

- IEC Just Published: [www.iec.ch/online\\_news/justpub](http://www.iec.ch/online_news/justpub)

Stay up to date on all new IEC publications. Just Published details twice a month all new publications released. Available on-line and also by email.

- Electropedia: [www.electropedia.org](http://www.electropedia.org)

The world's leading online dictionary of electronic and electrical terms containing more than 20 000 terms and definitions in English and French, with equivalent terms in additional languages. Also known as the International Electrotechnical Vocabulary online.

- Customer Service Centre: [www.iec.ch/webstore/custserv](http://www.iec.ch/webstore/custserv)

If you wish to give us your feedback on this publication or need further assistance, please visit the Customer Service Centre FAQ or contact us:

Email: [csc@iec.ch](mailto:csc@iec.ch)  
Tel.: +41 22 919 02 11  
Fax: +41 22 919 03 00

# INTERNATIONAL STANDARD

---

**Industrial communication networks – Fieldbus specifications –  
Part 3-3: Data-link layer service definition – Type 3 elements**


Withhold

## CONTENTS

FOREWORD.....	5
INTRODUCTION.....	7
1 Scope.....	8
1.1 Overview.....	8
1.2 Specifications.....	8
1.3 Conformance.....	8
2 Normative references.....	9
3 Terms, definitions, symbols, abbreviations and conventions.....	9
3.1 Reference model terms and definitions.....	9
3.2 Service convention terms and definitions.....	10
3.3 Common data-link service terms and definitions.....	11
3.4 Additional Type 3 data-link specific definitions.....	13
3.5 Common symbols and abbreviations.....	15
3.6 Additional Type 3 symbols and abbreviations.....	16
3.7 Common conventions.....	18
3.8 Additional Type 3 conventions.....	19
4 Connectionless-mode data-link service.....	19
4.1 General.....	19
4.2 Model of the connectionless-mode data-link service.....	20
4.3 Sequence of primitives.....	21
4.4 Detailed description of DL services.....	25
5 DL-management Service.....	44
5.1 General.....	44
5.2 Facilities of the DLMS.....	44
5.3 Services of the DL-management.....	44
5.4 Overview of interactions.....	46
5.5 Detailed specification of services and interactions.....	47
Bibliography.....	68
Figure 1 – Relationships of DLSAPs, DLSAP-addresses and group DL-addresses.....	12
Figure 2 – SDA service.....	22
Figure 3 – SDN service.....	23
Figure 4 – SRD service.....	23
Figure 5 – MSRD service.....	24
Figure 6 – CS service.....	24
Figure 7 – Reset, Set value, Get value, Ident (local), DLSAP status, DLSAP activate, DLSAP activate responder, DLSAP activate subscriber and DLSAP deactivate services.....	47
Figure 8 – Event service.....	47
Figure 9 – Ident (remote) service.....	47
Table 1 – Summary of DL services and primitives.....	22
Table 2 – SDA data ack primitives and parameters.....	26
Table 3 – Values of DL_status for the SDA data ack service.....	28
Table 4 – SDN data primitives and parameters.....	29

Table 5 – Values of DL_status for the SDN data service .....	30
Table 6 – SRD data reply primitives and parameters.....	32
Table 7 – Values of Update_status for the SRD data reply service .....	33
Table 8 – Additional values of DL_status for the SRD data reply service .....	34
Table 9 – SRD reply-update primitives and parameters.....	34
Table 10 – Values of DL_status for the SRD reply-update service .....	35
Table 11 – MSRD MCT data reply primitives and parameters.....	37
Table 12 – MSRD DXM data reply primitive and parameters .....	39
Table 13 – CS time event primitives and parameters .....	40
Table 14 – Values of DL_status for the CS time event service .....	42
Table 15 – CS clock value primitives and parameters .....	42
Table 16 – Values of CS_status for the CS clock value service.....	43
Table 17 – Values of DL_status for the CS clock value service .....	44
Table 18 – Summary of DL-management services and primitives.....	46
Table 19 – Reset primitives and parameters .....	47
Table 20 – Values of DLM_status for the reset service.....	48
Table 21 – Set value primitives and parameters.....	48
Table 22 – Mandatory DLE-variables .....	49
Table 23 – Optional DLE-variables .....	49
Table 24 – Permissible values of mandatory DLE-variables .....	50
Table 25 – Permissible values of optional DLE-variables.....	50
Table 26 – Meaning of the values for the parameter isochronous_mode.....	51
Table 27 – Default reaction times and operating parameters for a master station for asynchronous transmission.....	51
Table 28 – Default reaction times and operating parameters for a slave station with asynchronous transmission.....	51
Table 29 – Default reaction times and operating parameters for master stations for coupling of synchronous and asynchronous transmission segments .....	52
Table 30 – Default reaction times and operating parameter for slave stations for coupling of synchronous and asynchronous transmission segments .....	52
Table 31 – Values of DLM_status for the set value service .....	52
Table 32 – Get value primitives and parameters .....	53
Table 33 – Additional mandatory DLE-variables in master stations.....	53
Table 34 – Permissible values of the additional DLE-variables in master stations.....	54
Table 35 – Values of DLM_status for the get value service .....	54
Table 36 – Event primitive and parameters.....	55
Table 37 – Mandatory DLL events and fault types .....	55
Table 38 – Permissible values of T <sub>SH</sub> .....	55
Table 39 – Ident primitives and parameters .....	56
Table 40 – Ident_list for the ident service .....	57
Table 41 – Values of DLM_status for the ident service (local) .....	57
Table 42 – Values of DLM_status for the ident service (remote).....	57
Table 43 – DLSAP status primitives and parameters.....	58
Table 44 – Values of DLM_status for the DLSAP status service .....	59

Table 45 – DLSAP activate primitives and parameters .....	59
Table 46 – DLSAP activate service_list.....	60
Table 47 – DLSAP activate DLSDU_length_list (SDA, SDN, SRD, MSRD and CS) .....	61
Table 48 – DLSDU lengths of SDA and SDN as used in the DLSAP activate service .....	61
Table 49 – DLSDU lengths of SRD and MSRD as used in the (master station) DLSAP activate service .....	61
Table 50 – DLSDU lengths of CS as used in the DLSAP activate service .....	62
Table 51 – Values of DLM_status for the DLSAP activate service .....	62
Table 52 – DLSAP activate responder primitives and parameters.....	62
Table 53 – DLSDU_length_list for the DLSAP activate responder service.....	63
Table 54 – DLSDU length of SRD and MSRD as used in the DLSAP activate responder service .....	63
Table 55 – Values of DLM_status for the DLSAP activate responder service.....	64
Table 56 – DLSAP activate subscriber primitives and parameters.....	65
Table 57 – DLSDU_length_list for the DLSAP activate subscriber service.....	65
Table 58 – DLSDU lengths of MSRD as used in the DLSAP activate subscriber service (master and slave stations).....	65
Table 59 – Values of DLM_status for the DLSAP activate subscriber service .....	66
Table 60 – DLSAP deactivate primitives and parameters .....	66
Table 61 – Values of DLM_status for the DLSAP deactivate service.....	67

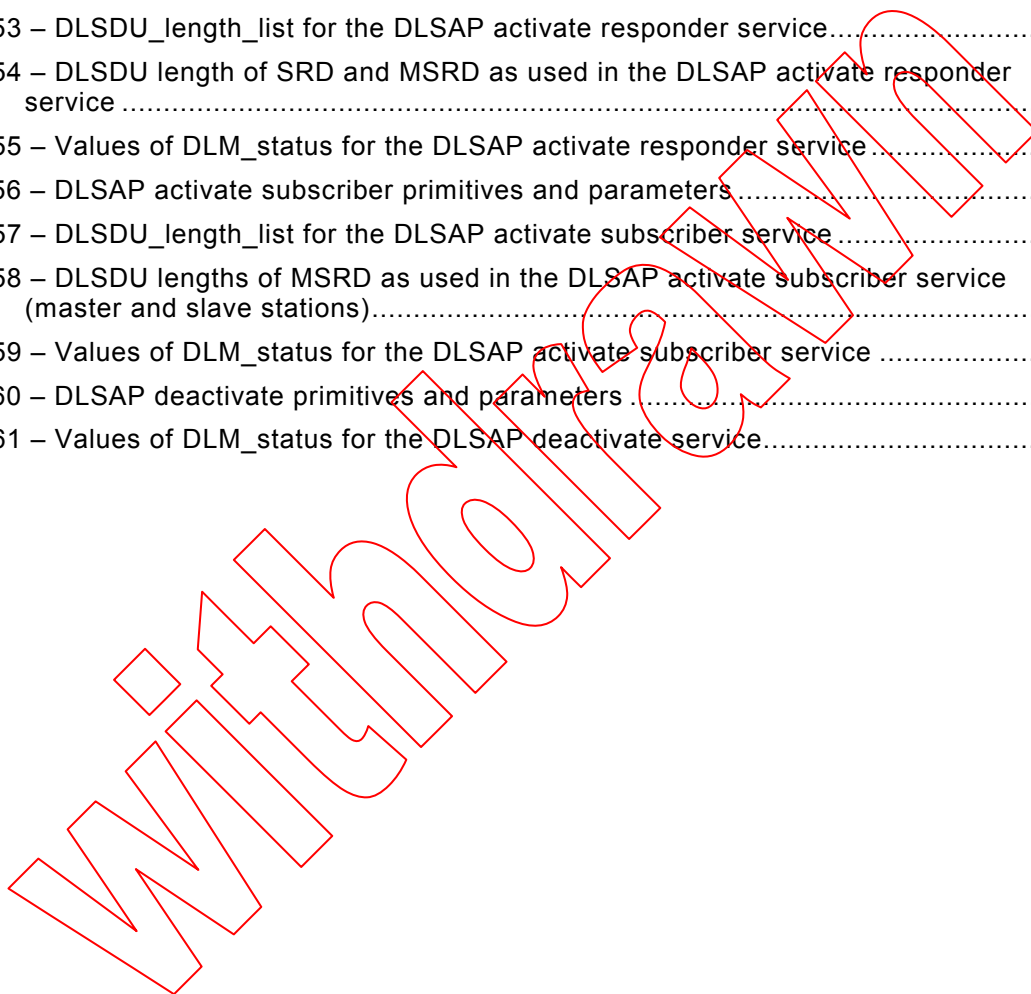

## INTERNATIONAL ELECTROTECHNICAL COMMISSION

---

**INDUSTRIAL COMMUNICATION NETWORKS –  
FIELDBUS SPECIFICATIONS –**
**Part 3-3: Data-link layer service definition – Type 3 elements**

## FOREWORD

- 1) The International Electrotechnical Commission (IEC) is a worldwide organization for standardization comprising all national electrotechnical committees (IEC National Committees). The object of IEC is to promote international co-operation on all questions concerning standardization in the electrical and electronic fields. To this end and in addition to other activities, IEC publishes International Standards, Technical Specifications, Technical Reports, Publicly Available Specifications (PAS) and Guides (hereafter referred to as "IEC Publication(s)"). Their preparation is entrusted to technical committees; any IEC National Committee interested in the subject dealt with may participate in this preparatory work. International, governmental and non-governmental organizations liaising with the IEC also participate in this preparation. IEC collaborates closely with the International Organization for Standardization (ISO) in accordance with conditions determined by agreement between the two organizations.
- 2) The formal decisions or agreements of IEC on technical matters express, as nearly as possible, an international consensus of opinion on the relevant subjects since each technical committee has representation from all interested IEC National Committees.
- 3) IEC Publications have the form of recommendations for international use and are accepted by IEC National Committees in that sense. While all reasonable efforts are made to ensure that the technical content of IEC Publications is accurate, IEC cannot be held responsible for the way in which they are used or for any misinterpretation by any end user.
- 4) In order to promote international uniformity, IEC National Committees undertake to apply IEC Publications transparently to the maximum extent possible in their national and regional publications. Any divergence between any IEC Publication and the corresponding national or regional publication shall be clearly indicated in the latter.
- 5) IEC provides no marking procedure to indicate its approval and cannot be rendered responsible for any equipment declared to be in conformity with an IEC Publication.
- 6) All users should ensure that they have the latest edition of this publication.
- 7) No liability shall attach to IEC or its directors, employees, servants or agents including individual experts and members of its technical committees and IEC National Committees for any personal injury, property damage or other damage of any nature whatsoever whether direct or indirect, or for costs (including legal fees) and expenses arising out of the publication, use of, or reliance upon, this IEC Publication or any other IEC Publications.
- 8) Attention is drawn to the Normative references cited in this publication. Use of the referenced publications is indispensable for the correct application of this publication.
- 9) Attention is drawn to the possibility that some of the elements of this IEC Publication may be the subject of patent rights. IEC shall not be held responsible for identifying any or all such patent rights.

NOTE Use of some of the associated protocol types is restricted by their intellectual-property-right holders. In all cases, the commitment to limited release of intellectual-property-rights made by the holders of those rights permits a particular data-link layer protocol type to be used with physical layer and application layer protocols in type combinations as specified explicitly in the IEC 61784 series. Use of the various protocol types in other combinations may require permission of their respective intellectual-property-right holders.

International Standard IEC 61158-3-3 has been prepared by subcommittee 65C: Industrial networks, of IEC technical committee 65: Industrial-process measurement, control and automation.

This first edition and its companion parts of the IEC 61158-3 subseries cancel and replace IEC 61158-3:2003. This edition of this part constitutes an editorial revision.

This edition includes the following significant changes with respect to the previous edition:

- a) deletion of the former Type 6 fieldbus, and the placeholder for a Type 5 fieldbus data-link layer, for lack of market relevance;
- b) addition of new types of fieldbuses;
- c) division of this part into multiple parts numbered 3-1, 3-2, ..., 3-19.